Skaneateles Lake Water Service Illustration

Illustration is not to scale

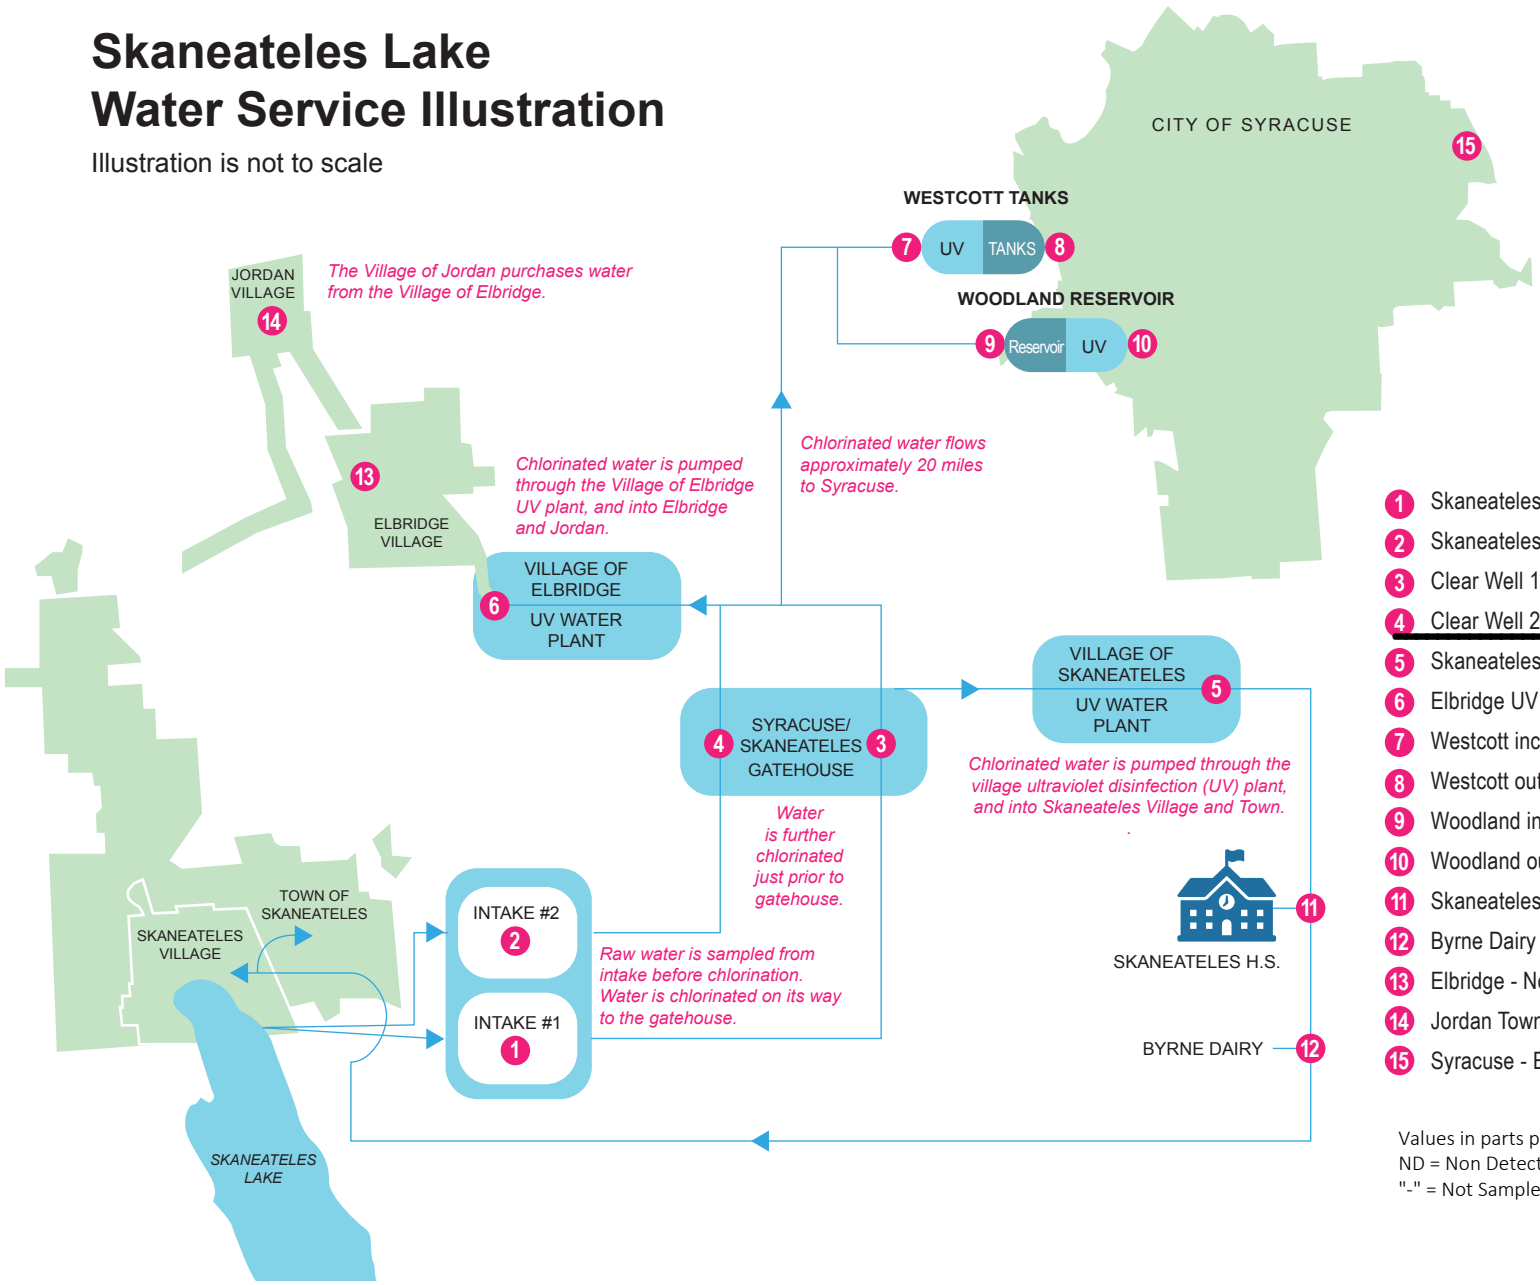

		Date Sampled		
		10/3	**10/2**	**10/1**
1	Skaneateles Gatehouse - Intake 1	0.37	0.28	0.20
2	Skaneateles Gatehouse - Intake 2	0.58	0.4	0.33
3	Clear Well 1 at Gatehouse	ND	0.16	ND
4	Clear Well 2/3 at Gatehouse	ND	0.19	0.16
5	Skaneateles UV Plant	ND	ND	ND
6	Elbridge UV plant	ND	ND	ND
7	Westcott incoming	-	-	-
8	Westcott outgoing to Syracuse	ND	ND	ND
9	Woodland incoming	-	-	-
10	Woodland outgoing to Syracuse	ND	ND	ND
11	Skaneateles HS	-	-	
12	Byrne Dairy	-	-	
13	Elbridge - North	-	-	-
14	Jordan Town Hall	-	-	-
15	Syracuse - Burnet & Thompson	-	-	-

Values in parts per billion (ppb)
ND = Non Detect
"-" = Not Sampled

NEW YORK STATE | Department of Health